



See Model Options on Page 2

Adjustable Operating Range	Minimum Deadband	Proof Pressure	Factory Setting
25-300 PSIG	12 PSIG	400 PSIG	90/60 PSIG

NOTICE

Direct control of motors with HP ratings greater than those shown could damage the ADPS sensor resulting in sprinkler system damage and unintentional water flow. The installation of a pressure relief valve set at or below the systems maximum operating pressure is recommended.

Description

The Model ADPS is an Adjustable Deadband Pressure sensor with independent set and reset points that are adjustable throughout the entire operating range of the sensor. The minimum deadband (minimum span between set and reset points) may be obtained at any point in the operating range of the sensor. A change in pressure greater than the high setting will reposition the sensor mechanism to open or close a single snap-action electrical sensor. This control device is designed for use as an operating control in applications sensing air, water, or any fluid not harmful to the pressure connection, diaphragm or nitrile pressure-sealing o-ring.

CAUTION

The instances where an operating control would result in personal injury and/or loss of property, it is the responsibility of the installer to add devices (safety, limit controls) that protect against, or systems (alarm, supervisory systems) that warn of control failure.

NOTE: This device is not intended for applications in explosive environments or use with hazardous fluids.

Mounting and Installation

The Model ADPS is typically mounted in an upright position on a flat surface by two 1/4" screws through the mounting flanges on the base or by two 1/4 - 20 screws into the back of the base. (See Fig. 1 for mounting dimensions.) Locate the sensor where vibration, shock, and ambient temperature fluctuations are minimal.

Listings/Approvals

- UL Standard 508 Guide (NKPZ) and CSA Standard C22.2 No. 14-M Class (321106) for Pressure Operated Industrial Control Equipment.
- UL Standard 873 Guide (XAPX) and CSA Standard C22.2 No. 24 Class (481302) for Temperature Indicating and Regulating Equipment.
- CE Marked

Ambient/Media Temperature Range

-4°F to 180°F (-20°C to 82°C)

Construction

- NEMA Type 4X enclosure for indoor or outdoor use. (To maintain 4X rating, use appropriate Type 4 conduit hub.)
- Forged brass or 316 S.S. pressure connections
- Aluminum Diecast base with Polymer enclosure
- Beryllium Copper diaphragm (Stainless steel isolator diaphragm included for protection of beryllium copper diaphragm on models with stainless steel pressure connection.)
- Nitrile Pressure Sealing O-ring

Sensor contact:

- Snap-action SPDT (Form C)
- 15 Amps at 125 VAC*
- 8 Amps at 250 VAC*
- 1/8 HP at 125 VAC
- 1/4 HP at 250 VAC

* Non-inductive loads only

NOTICE

To avoid damage to the sensor always hold a wrench on the pressure connection hex when tightening pressure connections. Never tighten the pressure connection by turning the sensor housing into the fitting.


Wiring

Use properly rated temperature supply wire for the anticipated service temperature. Make all electrical connections in accordance with the National Electrical Code and local regulations. A wiring check may be performed by manually actuating the sensor actuator on the side of the snap-action sensor inside the enclosure. (See Fig. 3)

NOTICE

Do not loosen or remove the two (2) screws that secure the sensor to the sensor mounting bracket.

Fig. 1

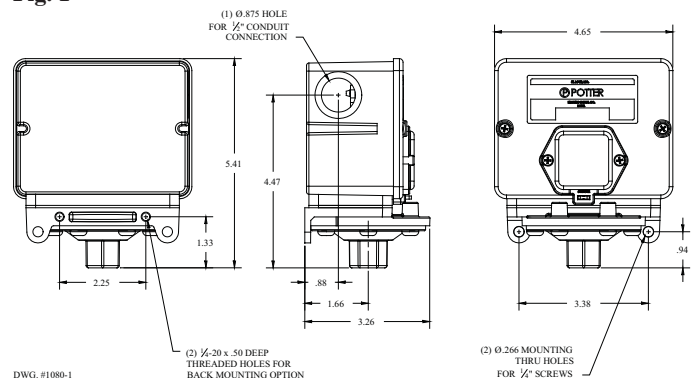


Adjustments

The two thumb adjustment dials, accessible through the enclosure cover, are used to adjust the set point and reset point of the switch. The dial scales and pointer may be used to give an indication of the low and high set points. The high setting adjustment dial is calibrated for increasing pressure. The low setting adjustment dial is calibrated for decreasing pressure. For best accuracy, make the final adjustments with a pressure gauge at the actual working media pressure and temperature encountered in the application.

The minimum deadband (minimum span between set and reset points) may be obtained at any point in the operating range of the switch. When the desired settings are obtained, replace the adjustment cover. The adjustment cover and enclosure cover can be made tamper resistant by a single sealing wire inserted through the hole in the locking bar. The repeatability of the set and reset points is typically $\pm 1\%$ of the operating range.

Fig. 3

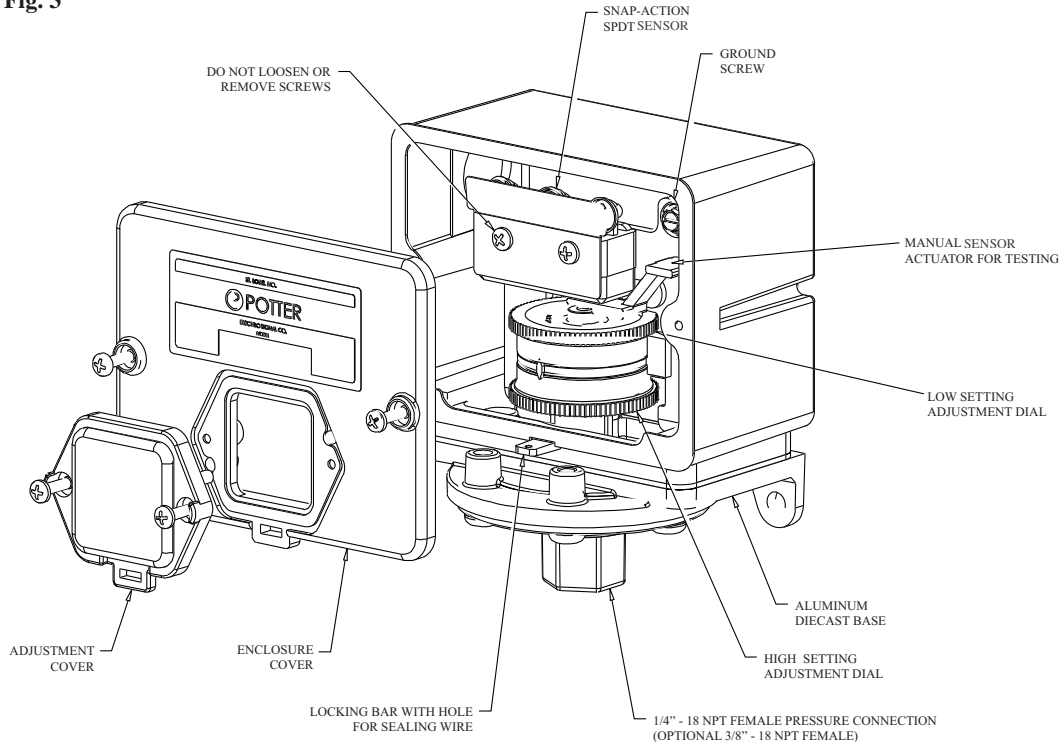

DWG# 1060-3

Ordering Information

Stock Number	Model Number	Adjustable Operating Range	Minimum Deadband	Proof Pressure	Pressure Connection	Diaphragm
1370010	ADPS-300-1B	25-300 PSIG	12 PSIG	400 PSIG	1/4" NPT Brass	Beryllium Copper
1370020	ADPS-300-1S	25-300 PSIG	12 PSIG	400 PSIG	1/4" NPT 316 S.S.	Beryllium Copper w/ 316 S.S. Isolator
1370030	ADPS-300-2S	25-300 PSIG	12 PSIG	400 PSIG	3/8" NPT 316 S.S.	Beryllium Copper w/ 316 S.S. Isolator
1370040	ADPS-600-1B	50-600 PSIG	25 PSIG	650 PSIG	1/4" NPT Brass	Beryllium Copper
1370050	ADPS-600-1S	50-600 PSIG	25 PSIG	650 PSIG	1/4" NPT 316 S.S.	Beryllium Copper w/ 316 S.S. Isolator
1370060	ADPS-600-2S	50-600 PSIG	25 PSIG	650 PSIG	3/8" NPT 316 S.S.	Beryllium Copper w/ 316 S.S. Isolator